

Daylighting Performance in Balai Padang Adat House at South Borneo

Febby R. Masruchin¹, I Gusti Ngurah Antaryama¹, Sri Nastiti N. Ekasiwi¹, and Desak P. Damayanti²

Abstract— *Balai Padang Adat is one of the traditional building in tropical area. The characteristic of this building is large, long and deep dimension but it has limited area of the openings. Field measurement for 3 days and 3 times (09.00, 12.00, 15.00) is used to identify factors that affect daylighting performance. This research found that daylighting performance was in poor quality. The outdoor illumination is very high which reached 100.000 lux caused by latitude, altitude and cloud cover. The latitude is 2° in the south from the equator's line and the altitude is 450 meters above sea level which close from the sun. The cloud cover is minimum lower than 40%. The indoor illumination can reach 1 lux as the lowest level during the day caused by obstruction, overhang, shape and space of the building, material reflectance, area and position of the openings. There is a building in the west and east and a vegetation in the south as an obstruction. This building has a large dimension with double layer room, but it has minimum material reflectance of the wall and floor. This building has a minimum area of the openings, high position of the openings near the overhangs and also long dimension of the overhang. Measurement was done in Laras-Pematang room as a living room and Bilik room as a bedroom and kitchen. Overall, daylighting performance of this building can not meet standart activity such as illumination value, daylighting factors and daylighting distribution from morning to the evening.*

Keywords—*Balai Adat Padang House, Daylighting, Traditional Building, Tropical Climate*

I. INTRODUCTION

Balai Padang Adat House at South Borneo is one of the traditional building inhabited by Dayak Meratus people. It is located in the tropical area that has a large potention of daylighting for passive systems of lighting from morning to evening (figure 1). Balai Padang Adat House is the biggest one on the map and small building around is the housing of each family.



Figure 1. Balai Padang Adat House Location

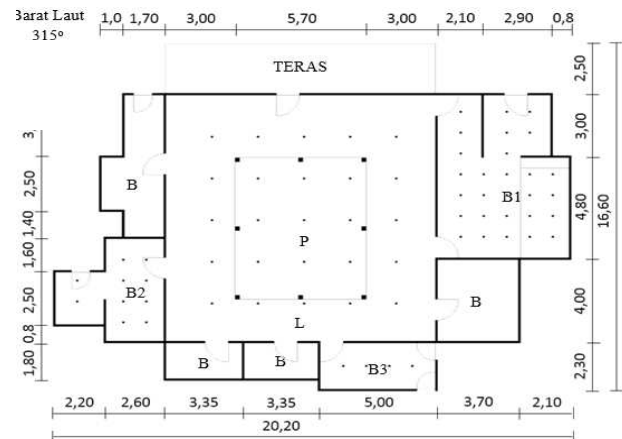


Figure 2. Balai Padang Adat House Plan



Figure 3. Daylighting Condition in Balalai Padang Adat House

Balai Padang Adat House has a large, long and deep dimension with double layer room (figure 2), but has only minimal openings between the wall and the roof extends from end to end of the wall and high opening (figure 3) which does not required with previous research minimum WWR 20% and high recomendation up to work plan 1,7 meters [16].

This research is important because there is a different activity of the occupant in the last and present. The design was adapted to the conditions of past occupants which did activity out of the building from morning (06.00 AM) to the evening (18.00 PM) because all of the people worked in the fields that has a far location from this building [9]. In the present, occupants do many activity in the building from morning to evening. Now, there are only traditional ceremonies every year and people does not live in this building because there are many part of the building is broken. But there are potention to reuse this building if it has been repaired.

Balai Padang Adat House is located in 2°29'59" – 2°56'10" south latitude, highlands area 450 meters above sea level and has a distance 138 kilometers from the city. There are 3 tipes of Balai Adat in South Borneo, Balai Padang, Balai Jalai and Balai Bidukun [9]. They have different characteristics related Building and openings.

¹Febby R. Masruchin, I Gusti Ngurah Antaryama, Sri Nastiti N. Ekasiwi are with Departement of Architecture, Institut Teknologi Sepuluh Nopember, Surabaya, 60111, Indonesia. E-mail: febbyrahmatullah@gmail.com; nastiti@arch.its.ac.id.

²Desak Putu Damayanti with Research Institute for Human Settlement – Ministry of Public Work, Denpasar, Indonesia. E-mail: damabalaipu@gmail.com

Balai Bidukun and Jalai have openings on the roof as a toplighting strategy.



Figure 4. Balai Adat House. Bidukun Type (Left), Jalai Type (Centre) and Padang Type (Right)

Building in tropical climate has 2 design strategy related openings, toplighting and sidelighting [7]. There are 4 component of toplighting, clerestory, monitor, sawtooth and skylight. This strategy is used in large building and has a long depth. Sidelighting can be used in small building because it can not reach area far from the openings. There are 3 factors that affect sidelighting strategy, shape, area and opening position [14]. Increasing opening area or window to wall ratio (WWR) can increase daylight factors. Increasing opening position can increase daylight factors. Vertical shape of the openings is better than horizontal shape. In the previous research, increasing 10% openings area can increase 7% illumination value. Better recommendation of opening area is 20% related to the previous research [15]. Better recommendation for openings position is 2.7 to 3 meters of upper opening and 1 meters or lower openings [16]

There are several factors that support daylighting performance related share, area and opening position. They are overhang, material reflectance, shape and dimension of the building and obstruction [7]. If the overhang is getting longer, it can decrease daylighting performance. Increasing 0.7 meters length of overhang can decrease 8% illumination and 2 meters can decrease 25% [10]. Minimum ratio length of overhang and high of the opening is 1 : 1.2 for better daylighting performance. Material reflectance affect daylighting distribution inside the building. Using low material reflectance can decrease illumination value 33% for wall, 33% for floor and 51% for ceiling [5]. Dimension of building related floor area and depth. Larger room affect decreasing daylighting performance because daylight can not distribute evenly. Obstruction such as trees and buildings can minimize daylighting enter into the room. Factors related obstruction is distance and high of the obstruction.

Sun as a source of natural lighting can be divided into 3 types, daylight, sunlight and reflected light. Tropics area is dominated by daylight and overcast sky condition 10.000 lux. Location of the object determine the latitude and altitude that can affect illumination level outside the building before enter to the buildings.

II. METHOD

This research use field measurement to identify daylighting performance on Balai Padang Adat and factors that affect it. The dependent variable related to the quantity of illumination value, Daylighting Factors (DF) and daylighting distribution. Result of illumination value is compared with standard illumination [12], result of daylight factors is compared with standard daylight factors [6] and result of daylighting distribution is compared with first standart [1] and second standard [13]

to identify daylighting performance related present occupant activity. Field measurement can be divided into 2 stages. First stage is measuring geometry of the building and second stage is measuring daylighting. Field measurement did on dry season (April to October) at 3 days and 3 times [13] (table 1).

TABLE 1.
MEASUREMENT TIME

No	Date	Time 1	Time 2	Time 3
1	12-08-2015	09.00	12.00	15.00
2	13-08-2015	09.00	12.00	15.00
3	14-08-2015	09.00	12.00	15.00

Daylighting measurement did indoors (figure 5) and outdoors (figure 6). Measurement is using lux meter tools with a LX1010BS model that has a 4% accuracy for illumination lower than 10.000 lux and 5% for illumination upper than 10.000 lux. Indoor measurement take place in 4 room and use TUU and TUS [11] and grid pattern every 1 meters in Bilik rooms and every 2 meters in Laras-Pematang rooms (figure 2). Total measurement spot in each room shown in table 2.



Figure 5. Indoor measurement



Figure 6. Outdoor measurement

TABLE 2.
MEASUREMENT SPOT IN ROOMS

Room	Total Measurement Spot
Laras-Pematang (LP)	24 spot every 2 meters
Bilik 1 (B1)	28 spot every 1 meters
Bilik 2 (B2)	9 spot every 1 meters
Bilik 3 (B3)	4 spot every 1 meters

III. RESULTS AND DISCUSSION

A. Occupant activity

Based on the observation, occupant did not live in Balai Padang Adat because there are many part of the building is broken. One of the example in Bilik floor is caused by bamboo material. Now, they lived in their homes around Balai Padang Adat House. Balai Padang Adat House is lived by people 1 week before ceremony and when it happen. There are traditional ceremonies every year tak place in Balai Padang Adat House.

Occupants did activity and lived in their own house shown in Table 3.

In the past, occupant did activity outside the building. Now, occupants do many activity inside the building. There are 3 factors that affect it, livelyhood systems, education and family member (Table 4).

B. Sky and cloud cover Condition

First and third day show outdoor illumination value is high because overcast condition of cloud cover. At the first day cloud cover condition at 09.00 and 15.00 is 40-60%, 0-10%, at 12.00 is 0-10%. At the second day, cloud cover condition at 09.00 until 15.00 is 80-100% (Figure 7). Third day show result as same as the first day.



Figure 7. Sky and Cloud Cover Condition

C. Outdoor Illumination value result

Outdoor illumination value show a high value in 3 days and 3 times. Minimum value is 11.400 lux at 15.00 PM and maximum value is 109.500 lux at 12.00 AM. Average outdoor illumination value for 3 days is shown in figure 5 below. First day and third day show the same pattern is caused by minimum cloud cover condition in first and third day.

D. Indoor Illumination value result

Indoor illumination value show a low value in Laras-Pematang room, Bilik 1 room, Bilik 2 room and Bilik 3 room although outdoor illumination value is very high. Average indoor illumination value for 3 days in each room shown in table 6, 7 and 8 below. Illumination standart for Laras-Pematang room as a living room is 120-250 lux, 120-250 lux for Bilik as a bedroom and 250 lux for Bilik as a kitchen [12].

TABLE 3.
 OCCUPANT ACTIVITY IN ROOMS ALL DAY

Time	01.00	02.00	03.00	04.00	05.00	06.00	07.00	08.00	09.00	10.00	11.00	12.00
Rooms	B	B	B	B	A	A	A	L	L	L	B-L	B-L
Time	13.00	14.00	15.00	16.00	17.00	18.00	19.00	20.00	21.00	22.00	23.00	24.00
Rooms	B-L	B-L	L	A	L-K	L-K	L-K	L-K	B-L	B	B	B

(A) All, (B) Bedroom, (L) Livingroom, (K) Kitchen

TABLE 4.
 FACTORS RELATED OCCUPANT ACTIVITY

Factors	Past Activity	Present Activity
Livelyhood Systems	Just farming on the field far from home	Many job and they can do it at home
Education	Children was not going to school, but help their parents to the field	Children go to school and do their home work from afternoon to evening at home
Family Members	Few members, nobody stay at home from morning to the evening	A lot of members, several members go to the field and the other do other job at home

TABLE 5.
 OUTDOOR ILLUMINATION

Value	09.00	12.00	15.00	
First day	Max	93.500	109.500	30.500
	Min	87.700	104.700	14.300
	Average	90.500	107.300	25.900
Second day	Max	36.000	64.100	16.700
	Min	24.100	37.400	11.400
	Average	27.500	49.800	13.100
Third day	Max	67.500	108.000	18.500
	Min	45.900	106.400	13.300
	Average	54.600	106.900	16.100

Illumination unit in that value is LUX

TABLE 6.
 INDOOR ILLUMINATION AT LARAS-PEMATANG

Time	Average	Maximum	Minimum
09.00	25,2 lux	83 lux	3,5 lux
12.00	36,4 lux	93 lux	8,5 lux
15.00	26,8 lux	165 lux	1 lux

TABLE 7.
 INDOOR ILLUMINATION AT BILIK 1

Time	Average	Maximum	Minimum
09.00	20,39 lux	171 lux	6,5 lux
12.00	57,81 lux	389 lux	9 lux
15.00	15,42 lux	190 lux	1 lux

TABLE 8.
 INDOOR ILLUMINATION AT BILIK 2

Time	Average	Maximum	Minimum
09.00	2,06 lux	4 lux	1 lux
12.00	2,94 lux	3,5 lux	2,5 lux
15.00	0,94 lux	2,5 Lux	0,5 lux

TABLE 9.
 INDOOR ILLUMINATION AT BILIK 3

Time	Average	Maximum	Minimum
09.00	28,75 lux	64,5 lux	5,5 lux
12.00	67,25 lux	193,5 Lux	12 lux
15.00	11 lux	23 Lux	2 lux

Average illumination value in Laras-Pematang room as a living room is not meet illumination standart (120-250 lux), Bilik 1, Bilik 2 and Bilik 3 room is also not meet standart illumination for as a bedroom (120-250 lux) and as a kitchen (250 lux). Maximum value take in several spot in room that is located near the openings or the door. Based illumination standard, design of Balai Padang Adat house is not meet standard for present occupant activity.

E. Daylight Factors result

Daylight factors show a low persentage in Laras-Pematang room, Bilik 1 room, Bilik 2 room and Bilik 3 room. Average Daylight Factors for 3 days in each room shown in table 9 below. Daylight Factor standard for Laras-Pematang room as a living room is 1,5%, 1% for Bilik as a bedroom and 2% for Bilik as a kitchen [6].

TABLE 10.
 DAYLIGHT FACTORS AT LARAS-PEMATANG

Function	Time	Average	Max	Min
Living room	09.00	0,07 %	0,20 %	0,01 %
	12.00	0,06 %	0,21 %	0,006 %
	15.00	0,10 %	0,35 %	0 %

TABLE 11.
 DAYLIGHT FACTORS AT BILIK 1

Function	Time	Average	Max	Min
Bed room	09.00	0,04 %	0,41 %	0 %
	12.00	0,03 %	0,26 %	0,002 %
	15.00	0,05 %	0,58 %	0 %
Kitchen	09.00	0,03 %	0,09 %	0,007 %
	12.00	0,04 %	0,09 %	0,01 %
	15.00	0,02 %	0,08 %	0,006 %

TABLE 12.
 DAYLIGHT FACTORS AT BILIK 2

Function	Time	Average	Max	Min
Bed room	09.00	0,004 %	0,01 %	0 %
	12.00	0,009 %	0,01 %	0,007 %
	15.00	0,004 %	0,008 %	0 %
Kitchen	09.00	0,003 %	0,003 %	0,003 %
	12.00	0,006 %	0,006 %	0,006 %
	15.00	0 %	0 %	0 %

Table 13.
 Daylight factors at bilik 3

Function	Time	Average	Max	Min
Living room	09.00	0,06 %	0,09 %	0,02 %
	12.00	0,05 %	0,13 %	0,01 %
	15.00	0,03 %	0,07 %	0,01 %

Daylight Factor is a resultan of SC (Sky Component), ERC (External Reflected Component) and IRC (Internal Reflected Component) [15]. we can find Daylight Factor use calculation persentage of indoor illumination value to outdoor illumination value [15]. as the result, Daylight Factors in this case is very low because indoor illumination is very low but outdoor illumination is very

high. Average Daylight Factors in Laras-Pematang room as a living room is not meet standart (1,5% Bilik 1, Bilik 2 and Bilik 3 room is also not meet standart as a bedroom (1%) and as a kitchen (2%).

Balai Padang Adat house has a worse Daylighting Performance from the result of illumination value and Daylight Factors which not meet standart for activity. We can see the performance from figure 3. Left picture show out of the building is very bright and we can not see inside the building from the dark colour in openings and doors. Centre and right picture show condition in Laras-Pematang room and Bilik room is dark.

F. Distribution of daylighting performance result

Indoor illumination and Daylight Factor is used to identify performance related to the activity in every room. Distribution of daylight is used to identify performance when light enter to the room. Daylight distribution is identified by 2 standart. First standart in table 14 to identify persentage area in the room that meet standart of illumination [1]. Second standart in table 15 to identify the possibility of glare which calculated from comparison of minimum illumination to average illumination value [13].

TABLE 14.
 DAYLIGHTING DISTRIBUTION (1ST STANDARD)

Room	Time	Value	Meassurement Spot
Laras-P	09.00	0 %	0 from 24 spot
	12.00	0 %	0 from 24 spot
	15.00	0 %	0 from 24 spot
Bilik 1	09.00	4 %	1 from 28 spot
	12.00	4 %	1 from 28 spot
	15.00	7 %	2 from 28 spot
Bilik 2	09.00	0 %	0 from 9 spot
	12.00	0 %	0 from 9 spot
	15.00	0 %	0 from 9 spot
Bilik 3	09.00	0 %	0 from 4 spot
	12.00	0 %	0 from 4 spot
	15.00	0 %	0 from 4 spot

TABLE 14.
 DAYLIGHTING DISTRIBUTION (2ND STANDARD)

Room	Time	Value	Average : Minimum
Laras-P	09.00	1 : 7,2	25,21 : 3,5 lux
	12.00	1 : 4,2	36,44 : 8,5 lux
	15.00	1 : 2,6	26,81 : 1 lux
Bilik 1	09.00	1 : 2,0	20,05 : 1 lux
	12.00	1 : 2,2	44,14 : 2 lux
	15.00	1 : 1,4	14,05 : 1 lux
Bilik 2	09.00	1 : 2,1	2,1 : 1 lux
	12.00	1 : 1,3	3,2 : 2,5 lux
	15.00	1 : 0,9	0,9 : 1 lux
Bilik 3	09.00	1 : 5,3	28,75 : 5,5 lux
	12.00	1 : 5,6	67,25 : 12 lux
	15.00	1 : 5,5	11 : 2 lux

Based on the first standard (Table 14), daylighting distribution in every room is not meet standard 40%. It show that daylighting can not distribute well in Laras-Pematang room, Bilik 1 room, Bilik 2 room and Bilik 3 room. Based on the second standard (Table 15), Laras-Pematang room is meet standard at 15.00 PM, Bilik 1 at 09.00 AM, Bilik 2 is meet standard all day and Bilik 3 did not meet standard at all. In Laras-Pematang, Bilik 1 and Bilik 3 rooms, there are high illumination value near the openings that make kontras between the area near the openings and area far from the openings.

Factors affecting the high value of illumination outside building

1) Latitude

Balai Padang Adat is located in south of equator line at 2°, it can make this area receive high sun radiation all year. Outdoor illumination measurement for 3 days and 3 times is very high because of this factor. Meanwhile, outdoor spot measurement is located in front of the building. Orientation of the building is 315° in North-West that can make the building receive high sun radiation all day in front, left and right of the building. Outdoor measurement spot receive high illumination of the direct sunlight with 20.000-90.000 lux at 09.00 AM, 30.000-100.000 lux at 12.00 AM and 10.000-30.000 at 15.00 PM.

2) Altitude

Meratus Highlands area is located in 450 meters above sea level. High outdoor illumination is also caused by this factors. In the tropics area, average illumination value is 10.000 lux, but in the field measurement this research found minimum outdoor illumination value is 11.400 lux at 15.00 PM. It show that this area has a high potentio of daylighting.

3) Cloud Cover

Overcast sky has a 90% of cloud cover. Observation for 3 days show minimum cloud cover (Figure 6). At the first day and third day, cloud cover condition at 09.00 and 15.00 is 40-60%, 0-10%, at 12.00 is 0-10%. At the second day, cloud cover condition at 09.00 until 15.00 is 80-100%. Minimum cloud cover in this location can support latitude and altitude position and cause high outdoor illumination value up to 100.000 lux.

Factors affecting the low value of illumination outside building:

1. Obstruction

Obstruction affect ERC (External Reflected Component) and can reduce daylight level. Balai Padang Adat house has an obstruction in left, right and behind the building (Figure 8). In the left side, there is a building 0,4 to 1 meters from Balai Padang. In the right side, there is a building 2 to 3 meters from Balai Padang and there is a vegetation as an obstruction behind Balai Padang. Obstruction in left, right and behind side can eliminate daylight level in Bilik rooms. There is no obstruction in the front of building, so Laras-Pematang room which located in front of the building receive a daylight higher than Bilik room. But, daylight in Laras-Pematang room is eliminated by overhang.

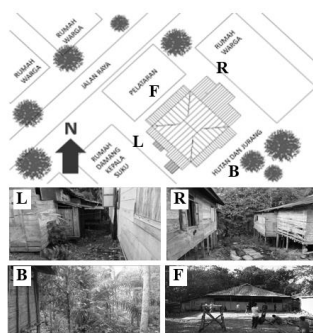


Figure 8. Obstruction Around Balai Padang Adat House

2. Overhang

Overhang is one of the design in tropical area. This building has an overhang on all sides because there is an opening all side of the internal and external wall. Overhang can be divided into 2 type in this building, long overhang in Laras-Pematang room and short overhang in Bilik room. Laras-Pematang room has a big dimation of the openings but also has a 3 meters length of obstruction. Meanwhile, Overhang in Bilik room has a short dimation 0.3 to 0.5 meters length but also has a small dimation of the openings.

Overhang above the openings can reduce daylighting level. Overhang 0.7 meters can reduce 8% illumination and overhang 2.5 meters can reduce 25% illuminance [3]. flat overhang can also reduce 38% illuminance [10]. this factor affect poor daylighting performance.



Figure 9. Overhang Condition. Long Overhang in Front of Building at Laras-Pematang Room (Left) and Short Overhang in Left, Right and Behind of Building at Bilik Rooms (Right)

3. Dimation of The Building

Dimation of building affect daylighting distribution inside the building [5]. Balai Padang Adat house has a total length of 20.2 meters, total width of 16.5 meters and total area of 262 m². Balai Padang Adat house has a Laras-Pematang room as a centre of the activity and Bilik room as a secondary activity around the Laras-Pematang room. It has a double layer configuration that can make natural lighting from the openings can not enter to the centre room of this building. Related to this configuration, daylighting strategy that can applied to this building is top lighting. Balai Padang Adat do not have a opening on the roof as a toplighting strategy. Natural light can enter by openings on the wall and illuminate area around the openings (figure 11 to fogue 17).

4. Material Reflectance

Material reflectance is very important to distribute natural lighting inside the building. Sequence elements that affect the reflectance in the building are ceiling, wall and floor [5]. Balai Padang Adat house do not have a ceiling and have a high position of the roof. Material on the wall and the floor is bamboo or wood which has a dark colour and low material reflectance (Figure 3).

Material reflectance in Balai Padang adat house is 5-10% [5] in floor and wall. Low material reflectance affect IRC (Internal Reflected Component), so that high outdoor illumination value up to 100.000 lux can not enter maximum into the building. Illumination value in Laras-Pematang room show higher than Bilik 1, 2 and 3 because there are yellow and green colour of window in Laras-Pematang room.

5. Opening Area

Opening area is defined by WWR (Window to Wall Ratio). Geometry measurement show that WWR less than 20% as a standart minimum WWR to get a good daylighting performance. All of the openings more than

20% of WWR in Laras-Pematang room. 3 from 8 openings more than 20% of WWR in Bilik 1 room. 2 from 7 openings more than 20% of WWR in Bilik 2 room. 2 from 4 openings more than 20% of WWR in Bilik 3 room.

Laras-Pematang room has a highest WWR 45% and there is no obstruction in there, but daylighting performance is poor because of long overhang 3 meters and large dimension of Laras-Pematang room. In another room, Bilik room has a small WWR 5-10%.

Opening area is one of the important factor for daylighting performance as a sidelighting strategy [5]. Minimum WWR in Balai Padang Adat less than 20% affect to the poor daylighting performance. There is a potentio to increase opening area until WWR 20% based on the previous research [15].

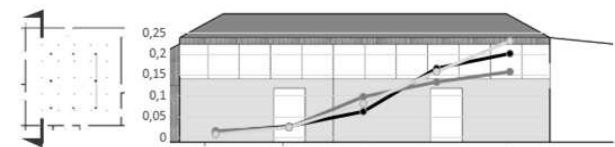


Figure 10. Opening area and position in Laras-Pematang room (Left), Bilik room (right) and material reflectance condition in floor and wall


6. Opening Position

Balai Padang Adat does not have window but openings between wall and roof. Opening position in this building is very high, 1.7 meters to 3.3 meters (Figure 10). This condition is not accordance with the previous research that give recomendation to opening position, upper openings less than 3 meters and lower openings more than work plan 1 meters [16]. opening position in Laras-Pematang room is 1.7 meters to 3.3 meters and opening position in Bilik room is 1.7 meters to 1.9 meters.

High openings is better to reach area far from the openings. In this case, opening position in every room is located behind the overhang. Large openings in Laras-Pematang room behind a long overhang 3 meters and small openings in Bilik room behind a small overhang 0.3 to 0.5 meters. There is no distance between upper of the openings to the lower of the overhang. It can reduce daylight enter from the openings and can not reach area far from the openings.




North-South Section of Daylight Factors on Laras-Pematang room

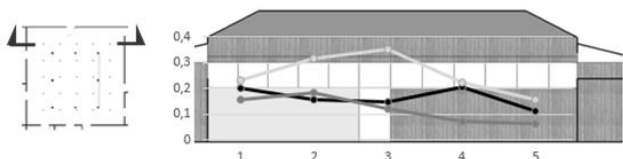


East-West Section of Daylight Factors on Laras-Pematang room




North-South Section of Daylight Factors on Bilik 1 room

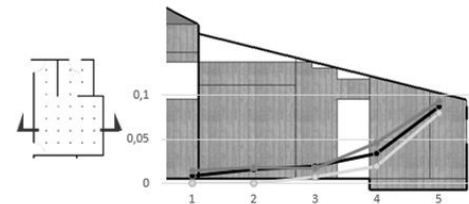


East-West Section of Daylight Factors on Bilik 1 room

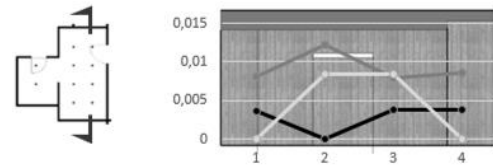

North-South Section of Daylight Factors on Bilik 2 room

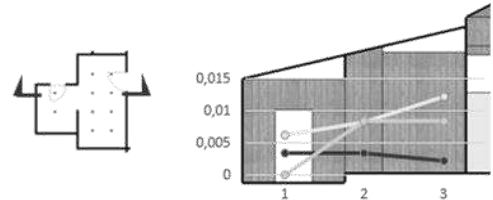

East-West Section of Daylight Factors on Bilik 2 room

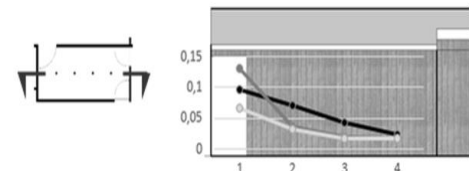

North-South Section of Daylight Factors on Bilik 3 room

— 09.00 AM — 12.00 AM — 15.00 PM

Figure 11. Daylight Factor Profile

Daylighting performance in every room is shown in figure 11 related Daylight Factor profile from the area near the openings to the area far from the openings. North-South Section of Daylight Factors on Laras-Pematang room show that daylight factor is not meet the standard, can not reach area in the south side and reduced in every measurement spot (2 meters). East-West Section of Daylight Factors on Laras-Pematang room show that daylight factor increase in area near the door. Door as a part of the openings is important to increase daylighting performance related present occupant activity.

There is a window in Bilik 1 room. North-South Section of Daylight Factors on Bilik 1 room and East-West Section of Daylight Factors on Bilik 1 room show that effect of window to increasing daylight level is not too significant. Daylighting performance is better in 4 meters area from the openings.

North-South Section of Daylight Factors on Bilik 2 room and East-West Section of Daylight Factors on Bilik 2 room show that daylighting distribution in every measurement spot is well because this room has a small dimension with openings around the wall that can enter daylight from the left, behind and front side from the outside.

Bilik 3 room is the smallest room in Balai Padang Adat house. North-South Section of Daylight Factors on Bilik

3 room show that decreasing daylight factor is not significant compared to the Laras-Pematang room and Bilik 1 room which has a large dimention.

IV. CONCLUSION

This research found that daylighting performance in Balai Padang Adat house was in poor quality. Large potentation of daylighting outside the building can not acomodate daylighting inside the building related to the standart illumination value, daylight factor and daylighting distribution for present occupant activity. The design of Balai Padang Adat house need to changed to achieve comfort. Large dimention of the building, obstruction in left-reght-behind of Bilik room, nimum material reflectance, there is no distance between overhang and the openings, small opening area with WWR less than 20% and high position of the openings is factors that affect daylighting performance in this case.

Field meassurement did in august indicating clear sky condition because outdoor illumination value can reach 100.000 lux. Therefore, necessary to study in other months that show condition of the overcast sky 10.000 lux to identify daylighting performance.

This house is not recomended for the activity because it does not meet activity standard. This study recommends to be a change in building. Therefore, it is necessary to do research to identify the influence of factors that affect the daylighting performance in Balai Padang Adat house.

ACKNOWLEDGEMENT

The authors would like to acknowledge to Dayak Bukit Society as an occupant of Balai Padang Adat house. This research was funded by Denpasar Experimental Station For Traditional Housing Technology Development Research Institute for Human Settlement – Ministry of

Public Work at the field observation stage and Lembaga Pengelola Dana Pendidikan (LPDP) at the theses report.

REFERENCES

- [1] Ander, Gregg D .(1995), *Daylighting Performance and Design*, John Wiley & Sons, Inc, Canada.
- [2] Egan, M.David dan Olgay, Victor W. (2002), *Architectural Lighting*, Second Edition, McGraw-Hill Company, NewYork.
- [3] Evans, Benjamin H, AIA, (1981), *Daylight in Architecture*, McGraw-Hill, Inc, New York.
- [4] Indrani, Hedy C, (2008), *Kinerja Penerangan Alam pada Hunian Rumah Susun Dupak Bangunrejo Surabaya*. Jurusan Arsitektur FTSP, Tesis ITS Surabaya.
- [5] Koenigsberger dkk, (1973), *Manual of Tropical Housing and Buildisfng*. Bombay: Orient Longman, India.
- [6] Littlefair, P, (2001), *Daylight, Sunlight and Solar Gain in The Urban Environment*, Vol. 70.3, hal 177-185.
- [7] Lechner, Nobert, (2009), *Heating, Cooling, Lighting, Sustainable Design Methods for Architects*, Prestel, New York.
- [8] Mangunwijaya, Y.B, (1994), *Pengantar Fisika Bangunan*. Jakarta: Djambatan.
- [9] Muchamad, Bani Noor dkk. (2007). *Anatomi Rumah Balai Adat*. Universitas Lambu Mangkurat dan Pustaka Banua, Banjarmasin.
- [10] Prianto, E., & Suyono, B. 2013. *Simulasi Efisiensi Energi Listrik pada Bangunan Ber-Greenwall di Semarang*. Semarang: JAFT Undip.
- [11] SNI 03-2396-2001 (2001), *Tata Cara Perancangan Sistem Pencahayaan Alami Pada bangunan Gedung*, Diunduh dari www.ciptakarya.pu.go.id.
- [12] SNI 03-6197-2000 tentang Konservasi Energi Sistem Pencahayaan pada Bangunan Gedung.
- [13] Steffy, Gary, (2002), *Architectural Lighting Design*, John Wiley & Sins, Inc, New York.
- [14] Szokolay, S.V. (2004), *Introduction to Architectural Science : The Basis for Sustainable Design 2nd Edition*. Architectural Press, London.
- [15] Urasa, (1998), *Passive Cooling and Daylighting in Hot Humid Climates. The Association of Energy Engineers publications*.
- [16] Wirawan, Ratna Mulianingsih, (2007), *Bukaan yang Efektif Untuk Pencahayaan Alami pada Rumah Tinggai di daerah Tropis Lembab*, Jurusan Arsitektur FTSP, Tesis ITS Surabaya.