

## OPERATIONAL PLANNING AND ENERGY MANAGEMENT OF A MICROGRID WITH A PV-BASED ACTIVE GENERATOR FOR SMART GRID APPLICATIONS

MANOJ D. PATIL

Department of Electrical Engineering, ADCET,  
 Ashta, Sangli, Maharashtra, India, mdpatileps@gmail.com

ANAND BHUPAL KUMBHAR

Department of Electrical Engineering, SGI, Atigre,  
 Kolhapur, Maharashtra, India, anandbkumbhar.abk123@rediffmail.com

**ABSTRACT:**

The development in the field of energy management tools may help to next generation, installations in solar cells and storage units which may provide the flexibility for control room operator. This paper tried to implement one of the best determinist energy management technique for industrial customers in microgrid, this also includes advance solar power generator with storage units and a smaller gas turbines. The implemented system organization divided in different categories and implementation carried out in two parts: central and local energy management. The load demand management is based on solar generation forecasting. The central and local energy systems exchange continous data via communication network. And based on the power flows between the various sources are managed via the SCADA control. In this paper application based on the case of a hybrid supercapacitor battery PV based generator is explained and implemented.

**KEYWORDS:** Load forecasting, Energy Management, Smart Grid, Renewable energy prediction, operation planning.

**INTRODUCTION:**

To reduce the green house gases and for the liberalization of the electricity market have directed large scale distributed energy generator in grids. In today's modern world renewable energy generator are used for consumption reduction of greenhouse gases. But most difficult part of renewable energy is continuous variation in output power causes excess variations in grid voltages and frequency. In recent years, storage systems had been use for the design of active generator which may provide an energy reserve with negligble fluctuation of output power[1].

Some days ago, smart energy meters were developed for collecting energy consumption data [2]. Continuous upgradation is been seen in energy meters to satisfy customer requirements and few meters were developed

so that they can automatic control the output load based on predefined pattern.

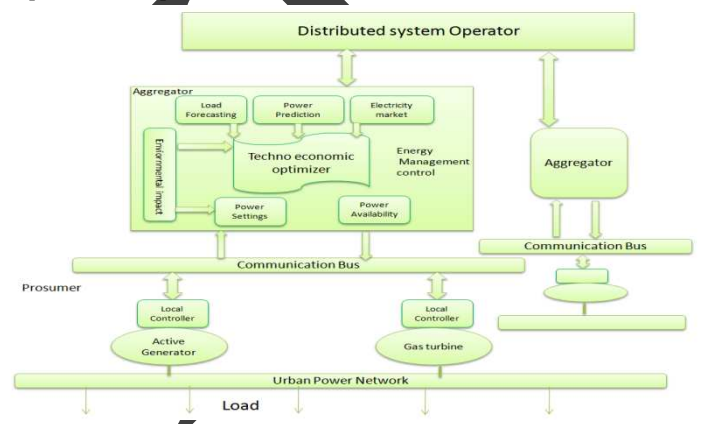


Fig. No.1. Central EMS framework

However implementation of these developments may require various changes in the design of grid control. In fig. no.1. overall architecture of an urban power system structure is considered as mean facilitate the combination of multiple distribute prosumers in electrical system and may be in the market. In this kind of architecture aggregators server the key role amidst prosumers and consumers on one side and the between DSO and market on other side as shown in fig.no.2.

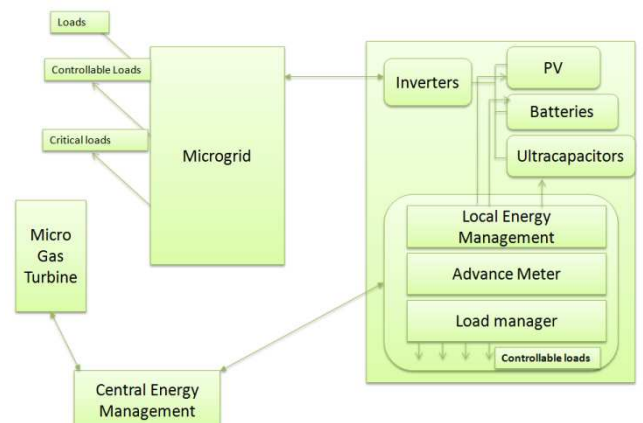


Fig. No. 2. Microgrid integration of a prosumer and a gas microturbine.

The main role of the aggregators is to collect the DSO the upcoming signals and signals from the prosumers, which may be located various locations. For gathering the market flexibilities and contributions provided by prosumers and consumers for efficient operation of the grid services.

In the prosumers area all electrical appliances, and distributed generation can be controlled by the Smart E-box which enable to communicate with external world.

**LOCAL ENERGY MANAGEMENT:**

For explaining the concept in detail with therotical developments, only one prosumers with gas microturbine are considered in microgrid shown in fig.no.3. The integration of load management, advanced metering and local energy management is accomplished by smart E-box.

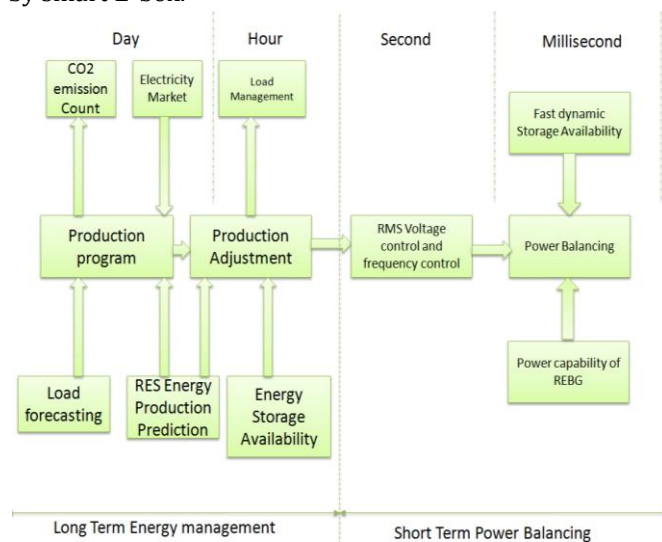


Fig. No.3. classification based on time for EMS facility

The load manager is designed in such a way that it automatically program appliances to turn on when tariff is lower for improving energy consumption habits. Moreover it can reduce a part of the power demand whenever the grid is under stress by facilitating the disconnection of programmed controllible loads.

Solar systems are provided with batteries, which can serves a purpose of long term electrical energy storage device[7] [8]. Few ultra capacitors are also involved for the purpose of fast dynamic power regulator all this items are coupled via Dc bus using choppers and connected with microgrid by using a inverter.

**LONG-TERM ENERGY MANAGEMENT:**

**PV Power Prediction and Load Forecasting:**

While carrying out this study, the solar energy prediction is very difficult and this is one of the biggest problem concerns with solar energy. The installed

photovoltaic panels generates the power only during day time and it has got the peak around midday mean which huge fluctuations in electrical power generation are expected.

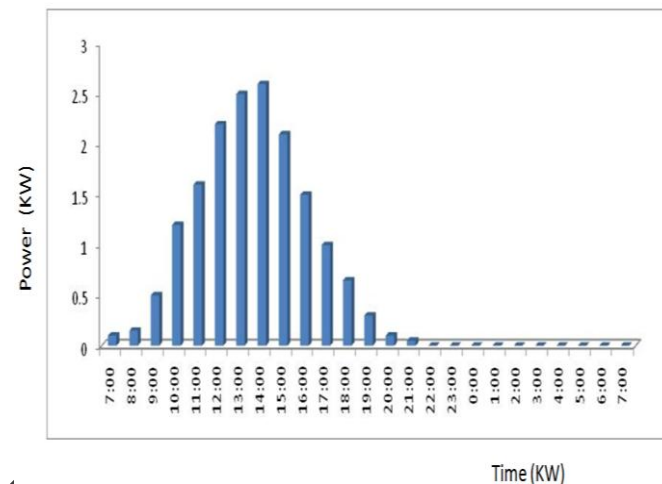


Fig. No.4. PV power prediction before 24Hour

Based on the weather forecasting and previous available data base 24 hour day ahead prediction of photovoltaic power is carried out as shown in fig. No.4. The load forecasting plays an very important role for the energy manager and it helps in managing the energy and the behavior of the loads can be estimated based on historical data.

**Energy Estimation:**

For the estimation of the energy, the initial conditions are need to be considered as the start time for the day ( $t_0$ ), and day's duration is termed as ( $\Delta t$ ). And more important thing is both parameters depend on the season and weather conditions as shown in fig. no.5.

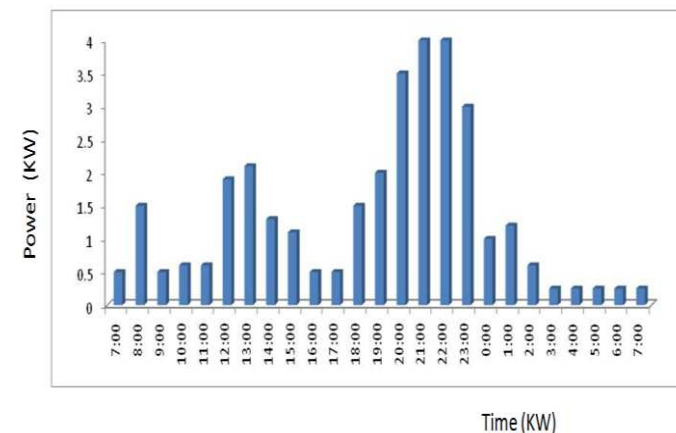


Fig. No. 5. Load forecasting 24hour ahead

The scheduled energy of the solar generation during each half-hour interval can be calculated as

$$\begin{aligned}\tilde{E}_{PV\_1/2h} &= \int_{t_0+nTe}^{t_0+(n+1)Te} \tilde{P}_{PV\_24h}(t)dt \\ &= Te \cdot \tilde{P}_{PV\_24h}(t_0 + n.Te)\end{aligned}$$

with  $Te = 30$  min and  $n \in \{0, 1, \dots, 47\}$ .

Load demand is also estimated for half hour and it can be calculated as

$$\begin{aligned}\tilde{E}_{Load\_1/2h} &= \int_{t_0+nTe}^{t_0+(n+1)Te} \tilde{P}_{Load\_24h}(t)dt \\ &= Te \cdot \tilde{P}_{Load\_24h}(t_0 + n.Te).\end{aligned}$$

Minimum power generated by microgas turbine is given by

$$\tilde{E}_{MGT\_1/2h\_min} = \int_0^{Te} P_{MGT\_min} dt = Te \cdot P_{MGT\_min}$$

Because of the rating limitation of the batteries the exchanged energy by batteries is given by

$$\tilde{E}_{bat\_1/2h\_max} = \int_0^{Te} P_{bat\_max} dt = Te \cdot P_{bat\_max}$$

#### EXPERIMENTAL RESULTS AND CONCLUSION:

For implementation of the proposed idea for energy management a software simulation was been made. While carrying out simulation 10 k-W batteries and two nos of 112KW (peak power) ultracapacitors were considered for storing electrical energy. First part of the results were obtained by using the hybrid generator and it is operated by using the storage mode of the ultracapacitor. As there will be no generation of electrical energy in the night mode, large variation in the grid power were obtained. For small step change in grid power reference may be from 0-200W occurs. The battery energy will be utilized for the supplying the load. However battery power cannot change suddenly, so ultracapacitors are normally discharged with a high power in order to this demand.

The second set of experiment is carried out in a day time and from grid reference 200W reference is generated. In this case batteries are discharging 100W of power and rest of part will be taken care by PV cells and it will respond to continuous variation of the grid reference voltage. However ultra capacitors are involved in power balancing task.

This paper concentrates on studies of microgrid organization and for defining the roles and required control system for the combination of dispersed solar

generator and DER units in electrical smart grids. The major concern is that the output power from all renewable energy sources keeps fluctuating, as it depends on the weather conditions. As mentioned in many research paper maximum solar power generation in India will 30% of the total demand in the country. Looking at this percentage contribution we can concentrate on commercialization of smart micro grids.

#### REFERENCES:

- 1) I. Hadipachalis, A. Poullikkas, and V. Efthimiou, "Overview of current and future energy storage technologies for electric power applications," *Renew. Sustain. Energy Rev.*, vol. 13, no. 6/7, pp. 1513-1522, Aug./Sep. 2009.
- 2) M. E. Glavin, P. K. W. Chan, S. Armstrong, and W. G. Hurley, "A standalone photovoltaic supercapacitor battery hybrid energy storage system," in *Proc. 13th Power Electron. Motion Control Conf.*, Sep. 1-3, 2008, pp. 1688-1695, [CD-ROM].
- 3) M. Liserre, T. Sauter, and J. Y. Hung, "Future energy systems, integrating renewable energy sources into the smart power grid through industrial electronics," *IEEE Ind. Electron. Mag.*, vol. 4, no. 1, pp. 18-37, Mar. 2010.
- 4) T. Zhou and B. François, "Modelling and control design of hydrogen production process for an active wind hybrid power system," *Int. J. Hydrogen Energy*, vol. 34, no. 1, pp. 21-30, Jan. 2009.
- 5) J. Hirsch, "Performance of open-standard PLV technologies on ERDF distribution network," in *Proc. Metering*, London, U.K., Jun. 9-10, 2009.
- 6) R. Hara, H. Kita, T. Tanabe, H. Sugihara, A. Kuwayama, and S. Miwa, "Testing the technologies— Demonstration grid-connected photovoltaic projects in Japan," *IEEE Power Energy Mag.*, vol. 7, no. 3, pp. 77-85, May/June. 2009.
- 7) X. Vallvé, A. Graillot, S. Gual, and H. Colin, "Micro storage and demand side management in distributed PV grid-connected installations," in *Proc. 9th Int. Conf. Elect. Power Quality Utilization*, Barcelona, Spain, Oct. 9-11, 2007, [CD-ROM].
- 8) S. J. Chiang, K. T. Chang, and C. Y. Yen, "Residential photovoltaic energy storage system," *IEEE Trans. Ind. Electron.*, vol. 45, no. 3, pp. 385-394, Jun. 1998.
- 9) Manoj D. Patil, Mithun Aush, and K. Vadirajacharya, "Grid Tied Solar Inverter at Distribution Level with Power Quality Improvement," *Int. J. Appl. Eng. Res.*, vol. 10, no. 9, pp. 8741-8745, 2015.
- 10) Manoj D. Patil, Mithun Aush, R. H. Madhavi "New Approaches for Harmonics Reduction in solar inverters," *Int. J. Adv. Found. Res. Sci. Eng.*, vol. 1, no. Special Issue, Vivruti-2015, pp. 1-7, 2015.
- 11) Manoj D. Patil, K. Vadirajacharya "Grid Tied Solar Using 3-Phase Cascaded H-Bridge Multilevel Inverter at Distribution Level with Power Quality Improvement," *Int. J. Adv. Found. Res. Sci. Eng.*, vol. 2, no. Special Issue, pp. 178-191, 2016.

- 12) Manoj D. Patil, K.Vadirayacharya "A New Solution to Improve Power Quality of Renewable Energy Sources Smart Grid by Considering Carbon Foot Printing as a New Element," *IOSR J. Electr. Electron. Eng. Ver. I*, vol. 10, no. 6, pp. 103-111 2015.
- 13) Manoj D. Patil, "Power Quality Improvement for Energy Saving," *Novat. Publ. Int. J. Innov. Eng. Res. Technol.*, vol. 3, no.5, pp. 89-94, 2016.
- 14) Mithun Aush, Manoj D. Patil, K.Vadirajacharya "Performance Analysis of Multilevel Inverter for Grid Connected System," *Int. J. Appl. Eng. Res.*, vol. 10, no. 9, pp. 8762-8764, 2015.
- 15) Mithun Aush, Manoj D. Patil, K.Vadirajacharya "Energy saving through power quality improvement 123," *Natl. J. Electron. Sci. Syst.*, vol. 5, no. 2, pp. 11-13, 2014.
- 16) Manoj D. Patil and Rohit G. Ramteke, "L-C Filter Design Implementation and Comparative Study with Various PWM
- 17) Techniques for DCMLI," in *IEEE Xplore Digital Library & International Conference on Energy Systems and Applications (ICESA-2015)*, 2015, no. Icesa 2015, pp. 347-352.
- 18) G. Delille and B. Francois, "A review of some technical and economic features of energy storage technologies for distribution systems integration," *Ecol. Eng. Environ. Protect.*, no. 1, pp. 40-49, 2009.
- 19) F. Baalbergen, P. Bauer, and J. A. Ferreira, "Energy storage and power management for typical 4Q-load," *IEEE Trans. Ind. Electron.*, vol. 56, no. 5, pp. 1485-1498, May 2009.
- 20) E. Figueres, G. Garcera, J. Sandia, F.-G. Espin, and J. Rubio, "Sensitivity study of the dynamics of three-phase photovoltaic inverters with an LCL grid filter," *IEEE Trans. Ind. Electron.*, vol. 56, no. 3, pp. 706-717, Mar. 2009.
- 21) RTE (Réseau de Transports d'Electricité) de France, *Consommation française d'électricité caractéristiques et methode de prevision*. [Online]. Available: <http://www.rte-france.com/>
- 22) R. Kaiser, "Optimized battery-management system to improve storage lifetime in renewable energy systems," *J. Power Sources*, vol. 168, no. 1, pp. 58-65, May 2007.
- 23) M. Lafoz, L. Garcia-Tabarés, and M. Blanco, "Energy management in solar photovoltaic plants based on ESS," in *Proc. 13th EPE-PEMC*, Poznan, Poland, Sep. 1-3, 2008, pp. 2481-2486, [CD-ROM].
- 24) B. Awad, J. Wu, and N. Jenkins, "Control of distributed generation," *Elektrotechnik & Informationstechnik*, vol. 125, no. 12, pp. 409-414, Aug. 2008.
- 25) H. Fakham, D. Lu, and B. Francois, "Power control design of a battery charger in a hybrid active PV generator for load-following applications," *IEEE Trans. Ind. Electron.*, vol. 58, no. 1, pp. 85-94, Jan. 2011.
- 26) D. Lu, T. Zhou, H. Fakham, and B. Francois, "Application of petri nets for the energy management of a photovoltaic based power station including storage units," *Renew. Energy*, vol. 35, no. 6, pp. 1117-1124, Jun. 2010.
- 27) B. Kroposki, R. Lasseter, T. Ise, S. Morozumi, S. Papathanasiou, and N. Hatziaargyriou, "Making microgrids work," *IEEE Power Energy Mag.*, vol. 6, no. 3, pp. 40-53, May/June 2008.
- 28) D. Lu and B. Francois, "Strategic framework of an energy management of a microgrid with photovoltaic-based active generator," in *Proc. Electromotion EPE Chapter*, Lille, France, Jul. 1-3, 2009, [CD-ROM].
- 29) J. Morren, S.W. H. de Haan, and J. A. Ferreira, "Contribution of DG units to primary frequency control," *Eur. Trans. Elect. Power*, vol. 16, no. 5, pp. 507-521, Sep./Oct. 2006.
- 30) J. Vasquez, J. Guerrero, A. Luna, P. Rodriguez, and R. Teodorescu, "Adaptive droop control applied to voltage source inverters operating in grid-connected and islanded mode," *IEEE Trans. Ind. Electron.*, vol. 56, no. 10, pp. 4088-4096, Oct. 2009.
- 31) E. Peeters, R. Belhomme, C. Battle, F. Bouffard, S. Karkkainen, D. Six, and M. Hommelberg, "Address scenarios and architecture for active demand development in the smart grids of the future," in *Proc. 20th CIGRE*, Prague, Czech Republic, Jun. 8-11, 2009, [CD-ROM].
- 32) N. Hatziaargyriou, H. Asano, R. Iravani, and C. Marnay, "Microgrids," *IEEE Power Energy Mag.*, vol. 5, no. 4, pp. 78-94, Jul./Aug. 2007.